

**Addendum No: One (01)**  
**Project: Sedalia Downtown Streetscape Phase IV**  
**Project No. 2019-03**  
**Date: June 27, 2019**

---

The following changes, additions, modifications, information and clarification are hereby made to the Specifications and/or plans dated June 3, 2019, and shall be incorporated in preparation of all Proposals for the Work.


#### **PLANS**

1. **CLARIFICATION – SHEET C-122:** Transverse joints should be Type D and longitudinal should be the choice of Type BS or Type C.
2. **CLARIFICATION – SHEET C-130:** Detail D1 should indicate a concrete slab thickness of 6” under and adjacent to the brick pavers, not 8”.
3. **DELETE** Detail G5 on **SHEET C-130** in its entirety and replace with the attached detail.
4. **CLARIFICATION – SHEET C-132, Structural Steel Note 9:** An inspector is not required if the Contractor provides the structural steel fabricators proof of AISC certification and it is found adequate in meeting all AWS D1.1 code requirements.
5. **CLARIFICATION – SHEET C-310:** All permanent signs shall be mounted on the proposed street light poles. Mounting hardware shall be considered subsidiary to the installation of the signs.
6. **DELETE SHEETS C-320 – C-325** in their entirety. There will no longer be traffic signals on this project.
7. **DELETE** the following Sheets in their entirety and replace with the attached revised sheets:
  - a. **C-000 - TITLE SHEET**
    - i. Removed Traffic Signal Sheets from Index of Sheets.
  - b. **C-001 - GENERAL NOTES & SUMMARY OF QUANTITIES**
    - i. Removed Traffic Signal Bid Item and Decorative Metered Service Pedestal from Summary of Quantities and added Bid Item “No Parking Zone Line”.
  - c. **C-120 - INTERSECTION DETAIL – S. OHIO & 6TH ST.**
    - i. Removed Traffic Signals.
  - d. **C-310 - PAVEMENT MARKING AND SIGNING PLAN – S. OHIO AVE.**
    - i. Added Stop Signs and Notes.
  - e. **C-400 - STREET LIGHTING PLAN – S. OHIO AVE.**
    - i. Removed Decorative Metered Service Pedestal. Added Pole Base Detail and Notes.
8. **CLARIFICATION – SHEET C-400** (Also applies to proposed Decorative Street Lights included in Add Alternate 1, N. Ohio Ave. – SHEET C-311):
  - a. **KCP&L Provides and Installs:**
    - i. **Decorative Light Poles**
    - ii. **Conductors**

- iii. Fixtures
- b. KCP&L Provides and Contractor Installs
  - i. Galvanized Anchor Bolts (This item considered subsidiary to work included with Bid Item, "Street Light Pole Base").
  - ii. Pull Box (Class 1)
- c. Contractor Provides and Installs:
  - i. Street Light Pole Bases
  - ii. 2" Sch. 40 PVC Conduit
  - iii. Pull String

#### **PROJECT MANUAL**

1. **CLARIFICATION – Job Special Provision F. Brick Pavers 5.2:** Payment for Brick Paver Crosswalks shall include all materials and labor to install the 6" concrete slab, sand leveling course, and pavers. Base rock to be paid for with "6" Type 1 Base" Bid Item.
2. **CLARIFICATION – Job Special Provision F. Brick Pavers 5.2:** Payment for Inlaid Brick Pavers at Sidewalk shall include all materials and labor to install the 3" concrete slab (shown on the attached Detail), sand leveling course, and pavers.
3. **CLARIFICATION – Bid Item for Paver Installation (City Supplied Pavers):** This Bid Item shall include all materials and labor to install pavers including, but not limited to, picking up and hauling the pavers to the job site from the Central Wastewater Treatment Plant on Main Street, sand leveling course, and 3" concrete slab.
4. **DELETE** the Proposal, pgs. 14-16, in its entirety and replace with the attached Proposal.

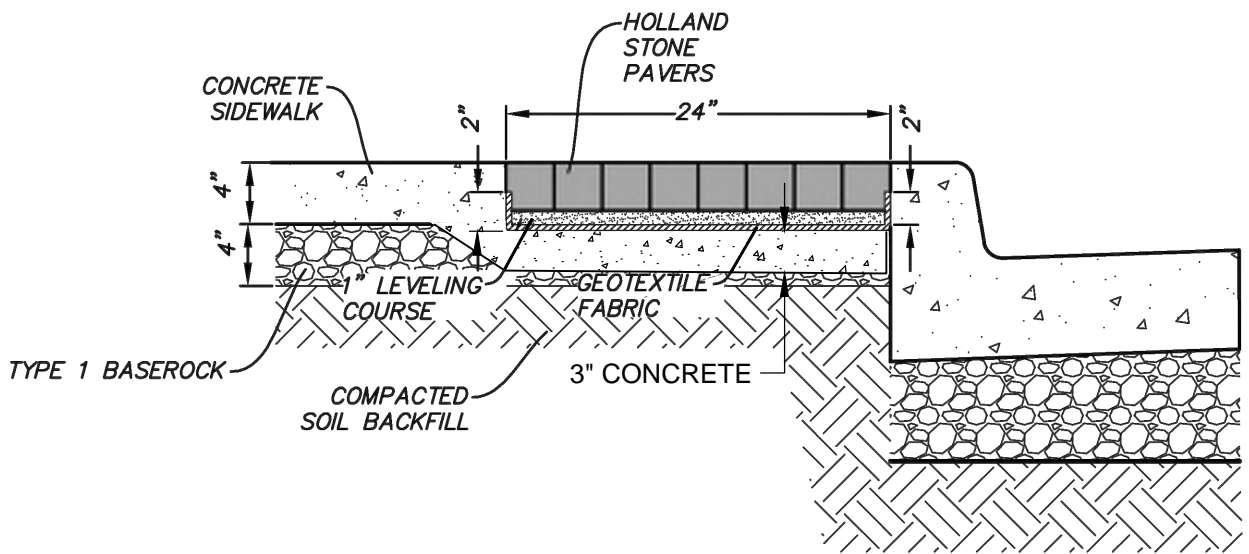

G5

## SIDEWALK WITH BRICK INLAY BEHIND CURB

NOT TO SCALE

INDEX OF SHEETS

C-000	TITLE SHEET
C-001	GENERAL NOTES & SUMMARY OF QUANTITIES
C-002	TYPICAL SECTIONS
C-100	GENERAL LAYOUT
C-110	PLAN & PROFILE - S OHIO AVE
C-111	PLAN & PROFILE - S OHIO AVE
C-112	PLAN & PROFILE - S OHIO AVE
C-113	PLAN & PROFILE - 6TH ST
C-114	PLAN & PROFILE - N OHIO AVE
C-120	INTERSECTION DETAIL - S OHIO & 6TH
C-121	INTERSECTION DETAIL - S OHIO & ALLEY
C-122	JOINING PLAN
C-130	ROADWAY DETAILS
C-131	ROADWAY DETAILS
C-132	ROADWAY DETAILS
C-133	STORM SEWER DETAILS
C-200	EROSION CONTROL PLAN
C-201	EROSION CONTROL DETAILS
C-300	TRAFFIC CONTROL PLAN - S OHIO AVE
C-301	TRAFFIC CONTROL PLAN - N OHIO AVE
C-310	PAVEMENT MARKING AND SIGNING PLAN - S OHIO AVE
C-311	PAVEMENT MARKING AND STREET LIGHTING PLAN - N OHIO AVE
C-400	STREET LIGHTING PLAN - S OHIO AVE
C-500	DRAINAGE AREA MAP AND CALCULATIONS
C-600	CROSS SECTIONS S OHIO AVE
C-601	CROSS SECTIONS S OHIO AVE
C-602	CROSS SECTIONS S OHIO AVE
C-603	CROSS SECTIONS S OHIO AVE
C-610	CROSS SECTIONS 6TH ST
C-611	CROSS SECTIONS 6TH ST
C-620	CROSS SECTIONS N OHIO AVE

# CITY OF SEDALIA, MISSOURI DOWNTOWN STREETScape, PHASE IV CITY PROJECT NO. 2019-03 FEDERAL PROJECT NO. STP-5700(511)

UTILITY CONTACTS

- WATER**  
SEDALIA WATER DEPARTMENT  
CHARLES BROSCHE  
PO BOX 806  
SEDALIA, MISSOURI 65302  
(660) 826-1234
- ELECTRIC**  
KCP&L  
ERIK HARDING  
921 PARKHURST DRIVE  
SEDALIA, MISSOURI 65301  
(877) 729-8696
- GAS**  
EMPIRE DISTRICT GAS COMPANY  
JIM HARGRAVE  
1601 SEDALIA ROAD  
SEDALIA, MISSOURI 65301  
(660) 827-3188
- TELEPHONE**  
AT&T  
STEPHEN HARLAN  
220 E 5TH ST.  
SEDALIA, MISSOURI 65301  
(816) 325-5657
- FIBER OPTIC**  
MISSOURI NETWORK ALLIANCE  
800 NW CHIPMAN ROAD, SUITE 5750  
LEE'S SUMMIT, MISSOURI 64063  
(888) 832-6662
- TELEVISION**  
CHARTER COMMUNICATIONS  
210 W 7TH ST.  
SEDALIA, MISSOURI 65301  
(888) 438-2427
- SANITARY SEWER**  
ALLIANCE WATER RESOURCES  
PHIL WEBSTER  
901 E 3RD ST.  
SEDALIA, MISSOURI 65301  
(660) 827-7830
- STORM SEWER**  
ALLIANCE WATER RESOURCES  
PHIL WEBSTER  
901 E 3RD ST.  
SEDALIA, MISSOURI 65301  
(660) 827-7830
- MoDOT**  
KANSAS CITY AREA - MARSHALL OFFICE  
MIKE McGRATH  
1593 WEST ARROW ST.  
MARSHALL, MISSOURI 65340  
(660) 886-2115

**WILSON & COMPANY**  
800 EAST 101ST TERRACE, SUITE 200  
KANSAS CITY, MO 64131  
PHONE: 816-701-3100  
FAX: 816-942-3013  
www.wilsonco.com  
Cert. of Authority # 2003007699

CONSULTANTS


PROJECT NAME  
CITY OF SEDALIA, MO  
DOWNTOWN STREETScape  
CITY PROJECT NO. 2019-03  
FEDERAL PROJECT NO.  
STP-5700(511)

REV.	DATE	DESCRIPTION	BY

PROJECT NO:	14-100-509-09
DESIGNED BY:	GJL, DJM
DRAWN BY:	GJL, DJM
CHECKED BY:	JCK, CDP
DATE:	6/3/2019

SHEET TITLE  
**TITLE SHEET**

SHEET NO:  
**C-000**

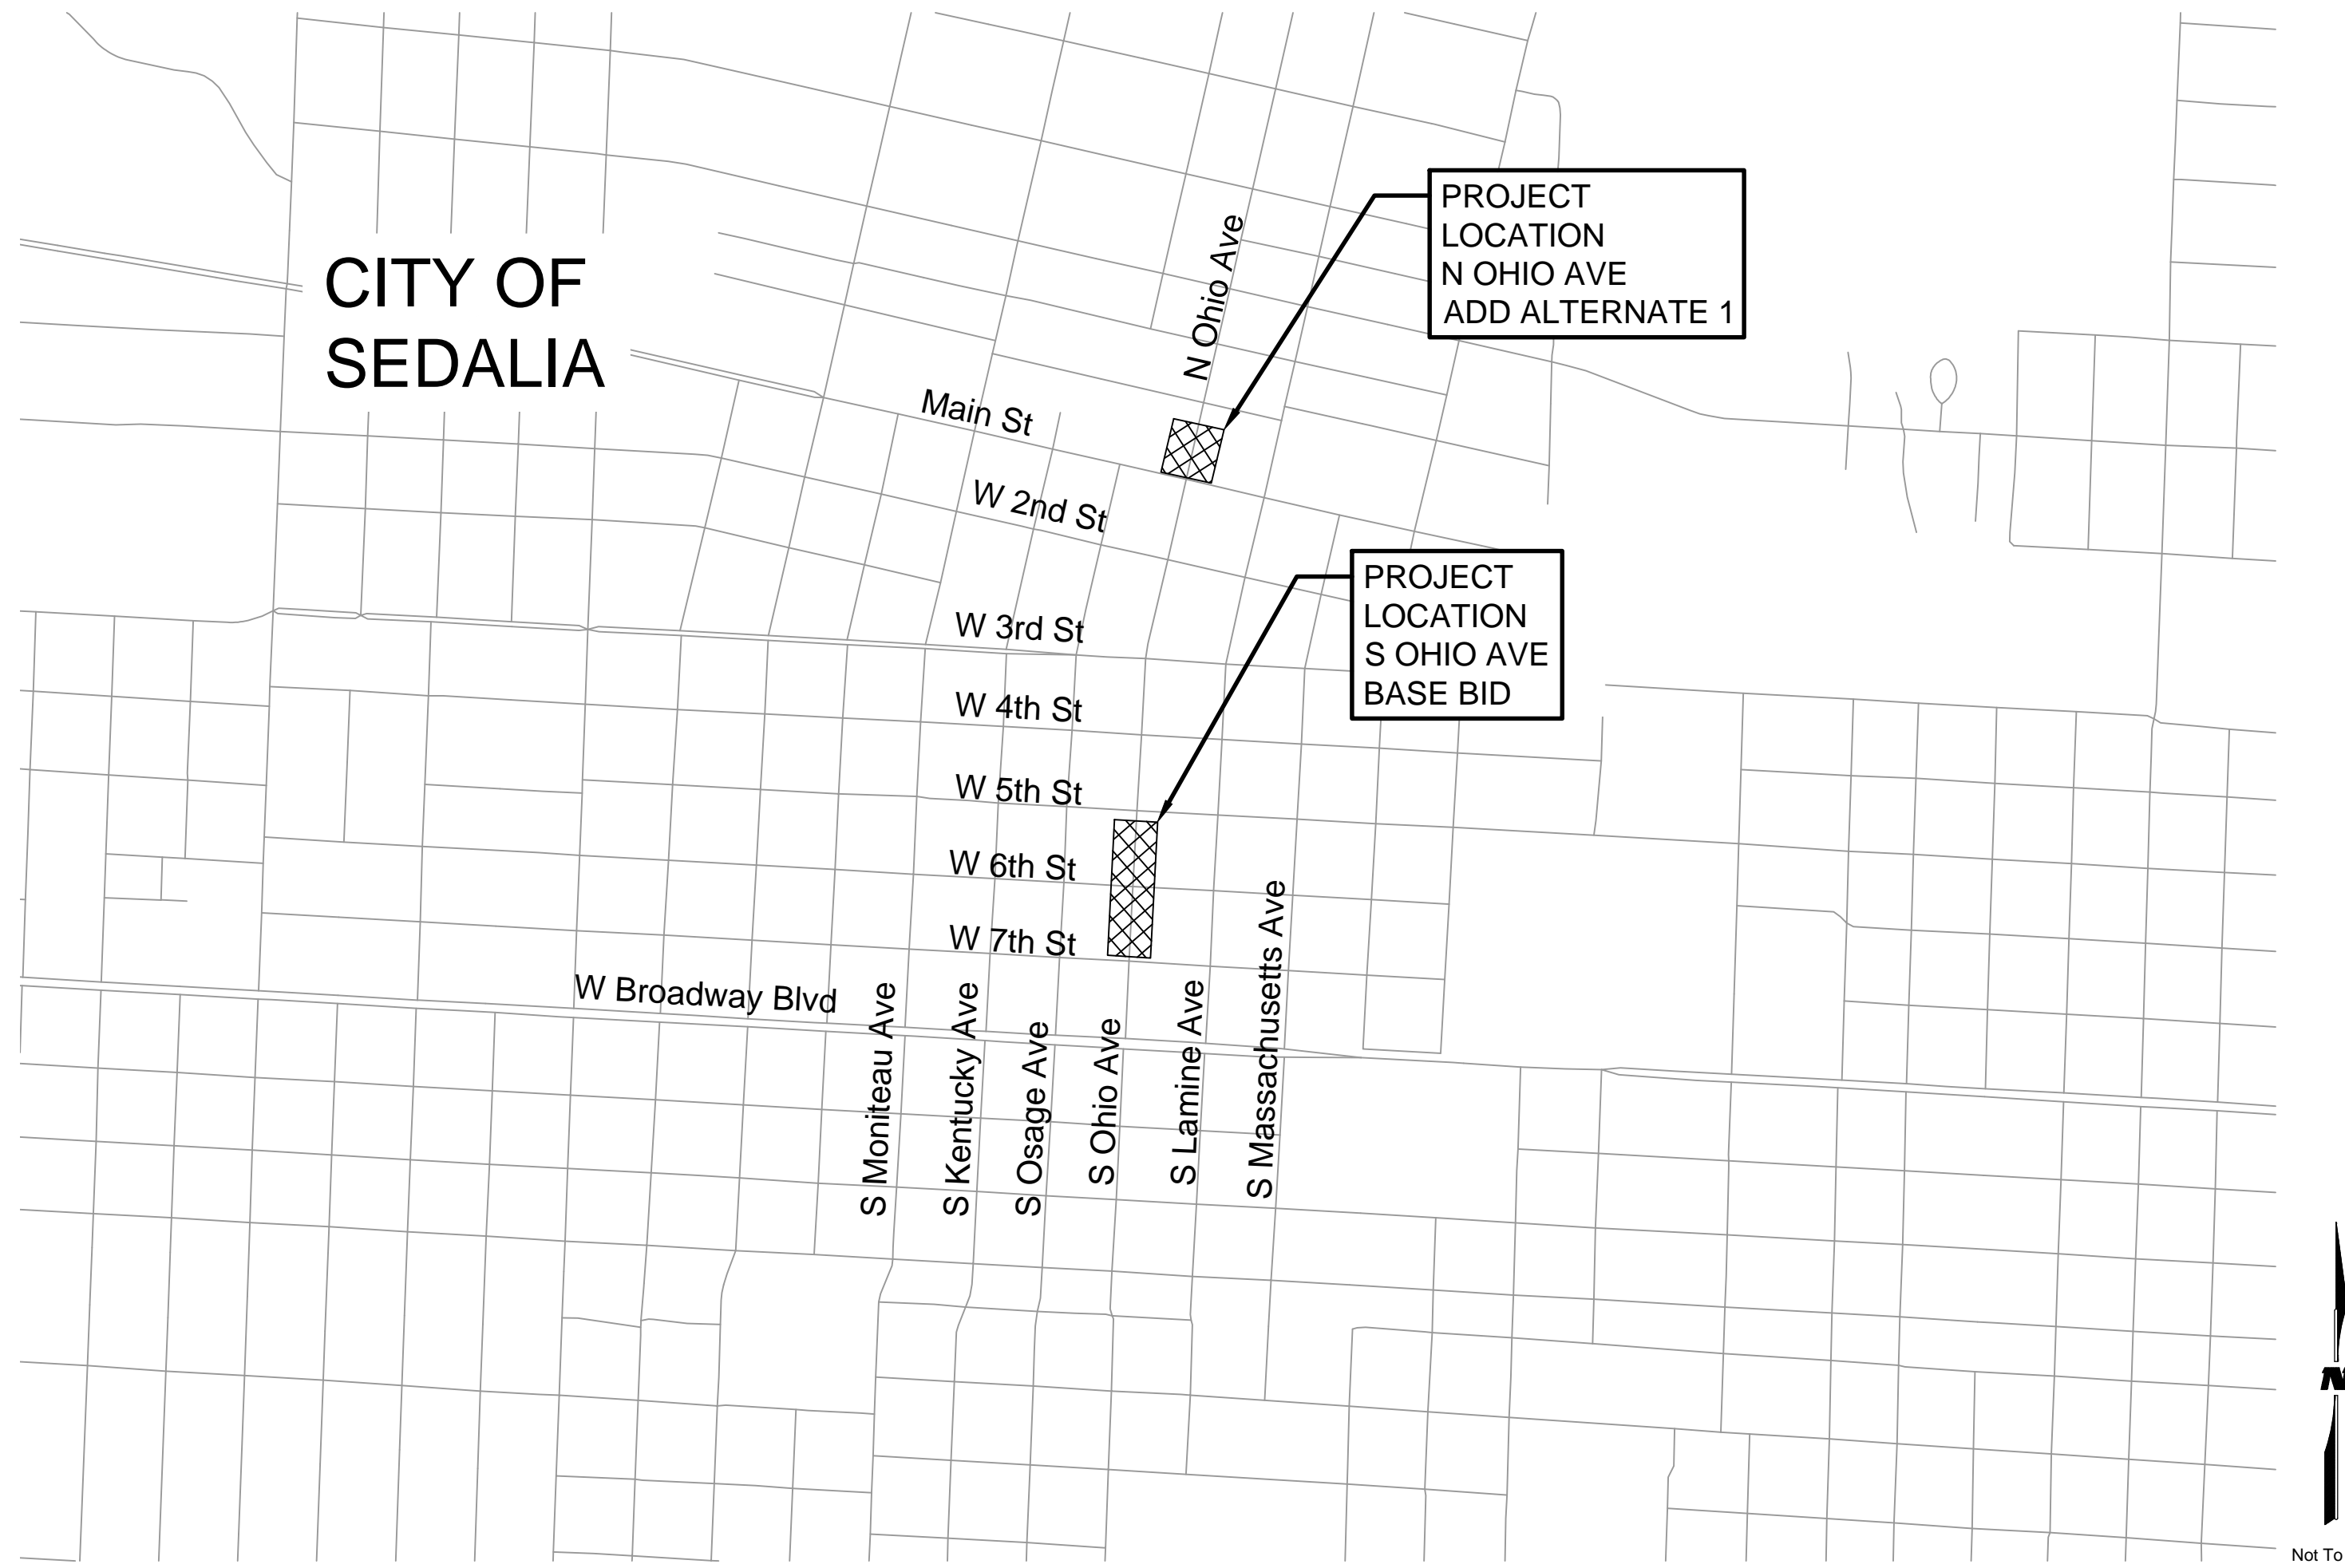

HATCH LEGEND

- CONCRETE PAVEMENT
- CONCRETE SIDEWALK
- BRICK PAVER
- BRICK CROSSWALK PAVER
- CONCRETE TRUNCATED DOME
- GRAVEL DRIVEWAY
- COAL CHUTE & BASEMENT OPENING

DESIGN DESIGNATION

FUNCTIONAL CLASSIFICATION	MINOR ARTERIAL
DESIGN SPEED	25 MPH
<b>BASE BID</b>	
OHIO BEGIN STATION	11+00.00
OHIO END STATION	16+12.21
PROJECT LENGTH	512 FEET
<b>6TH BEGIN STATION</b>	
6TH END STATION	20+35.00
6TH END STATION	21+60.00
PROJECT LENGTH	125 FEET
<b>ADD ALTERNATE 1</b>	
BEGIN STATION	50+10.00
END STATION	51+11.18
PROJECT LENGTH	101 FEET

*Brenda Ardrey*  
BRENDA ARDREY, DIRECTOR OF PUBLIC WORKS

*4/10/19*  
DATE

6/24/2019 M:\TRN\14-100-509-002\_Disciplines\_SHEETS2\_Sheets - civil\14150909 - Streetscape\14150909-G-001 Title.dwg

6/27/2019 M:\TRN\14-100-509-002\_Disciplines\_SHEETS2\_Sheets - civil\14150909 - Streetscape\14150909-C-001 General Notes Quant.dwg

GENERAL NOTES

- The construction covered by these plans shall conform to the "Missouri Standard Specifications for Highway Construction, 2018".
- Construction of the improvements shown or implied by this set of plans shall not be initiated or any part thereof undertaken until the City is notified of such intent and all required and properly executed bonds and contract agreements are received and approved by same.
- The Contractor shall have one (1) signed copy of the plans and one (1) copy of the appropriate Construction Specifications and Project Manual at the job site at all times. It is advisable that the Contractor become familiar with the City requirements and standards in the event that there is a discrepancy between this approved plan and the city requirements. Advise the City's Representative of any discrepancy prior to bidding or working on this project.
- The Contractor shall be responsible for obtaining all required permits, paying all fees and for otherwise complying with all applicable regulations governing the work.
- The accuracy and adequacy of the alignments, dimensions, and elevations shall be confirmed by the Contractor at the job site. If the Contractor finds any dimensions to be in error or in question, the City's Representative shall be promptly contacted for clarification prior to the continuation of the work. The engineering and geological data shown on these plans are from studies made in the field and represents the best information available prior to construction, at the time of testing.
- Notify the City's Representative at least 48 hours prior to beginning any work. For construction under driveways and streets, Contractor shall notify residents of construction activities well in advance of the work, and shall provide and maintain a temporary surface for access until permanent restoration is completed.
- The Contractor shall develop and implement proper traffic control in conformance with the latest revision of the MUTCD.
- During construction, access shall be maintained for emergency vehicles and local traffic. Contractor shall notify the City 72 hours prior to any street closures or blockages to allow the City adequate time to notify the fire, police and ambulance departments, schools, school bus companies, and post office of upcoming work. Closures and traffic plans are subject to approval of the City's Representative.
- Prior to commencement of work, the Contractor shall notify all those utility companies which have facilities in the vicinity 72 hours prior to the construction to be performed. The Contractor shall be held responsible for contacting all utility companies for field location of all underground utility lines, whether shown on these plans or not, prior to any excavation. All existing utility locations shown on the plans are taken from utility company records and are approximate only. Some service lines from building to main have unknown locations and may conflict with the plan. Relocation of said service lines required for the construction of this project shall be the responsibility of the Contractor and shall be at the Contractor's expense. The Contractor, prior to construction, shall verify the location and depth of all underground utilities. The repair of any damage to said utilities shall be at the cost to the Contractor. Any utilities found to be in conflict with the proposed construction, shall be brought to the immediate attention of the City's Representative.
- All utility and sanitary service lines shall be kept in service and protected during construction operations. It shall be the Contractor's responsibility to locate all existing service lines, and notify the City's Representative of any conflicts immediately. Occasional adjustments to the work to accommodate the unanticipated presence or location of existing utilities may be required and will be considered a subsidiary obligation of the contract. The Contractor shall be held responsible for contacting all utility companies for field location of all underground utility lines prior to any excavation. Utilities damaged through the negligence of the Contractor shall be repaired or replaced by the Contractor at his expense.
- Contractor shall be responsible for all service line relocations and lowerings. All service line relocation and lowerings must be approved by the City prior to relocating or lowering service. Once the service has been relocated or lowered, the service line must be inspected by the City prior to backfilling.
- The Contractor shall be responsible for supporting any water mains or gas mains horizontally and vertically when crossing under the existing main(s). If applicable, the Contractor will be responsible for supporting any gas main or water main laterally when working alongside any main(s).
- Contractor must coordinate the bracing of all utility poles with the Kansas City Power and Light prior to any excavation within 10 feet of a pole.
- All signs, mailboxes, and fencing in conflict with the proposed construction shall be removed and reset. Temporary fencing shall be installed at locations where existing permanent fencing exists; location shall be determined in the field. These items are considered incidental to the bid items.
- Temporary erosion control shall be installed per the specifications, or as warranted and determined in the field by the City's representative. Erosion controls must be in place prior to any site work and must be maintained continuously throughout the project. Payment for installation and continuous maintenance shall be incidental to the erosion control pay items.
- Clearing and grubbing operations and disposal of all debris there from shall be performed by the Contractor in strict accordance with all local, state, and federal laws, codes, and ordinances. Open burning of debris shall not be permitted.
- Driveways, sidewalk, and other areas inside and outside the construction limits damaged by the Contractor shall be restored to a condition equal to or better than that existed before damage occurred at the Contractor's expense. All catch basins, utility valves, hydrants, manholes, meter pits, etc. within grading limits shall be adjusted or rebuilt to grade as required. All inlets shall be graded to drain. No separate payment will be made for adjustments not noted in the plan notation and callouts.
- Existing trees not designated for removal shall be protected from damage during construction. Trees damaged during construction shall be pruned and wounds protected as approved by the City's Representative.
- It is the Contractor's responsibility to determine earthwork quantities. No classification of excavated materials will be made. No additional payment will be made for rock excavation. The Contractor is solely responsible for determining the amount of rock excavation, if any, to be included in his bid. Excavation work shall include the removal and subsequent handling of all materials excavated or otherwise removed in performance of the work, regardless of the type, character, composition, or condition thereof. All fill and backfill material shall consist of earth or other approved material free from organic matter with all undesirable material removed.
- All Contractor stockpiling, staging and employee parking shall be confined to the

- The top 6" of all fill shall be top soil, and shall be approved by the City's Representative prior to sod or seed installation. All back fill shall be tamped and organic top soil placed thereafter followed by seeding or sod as required by the specifications. No extra payment will be made for imported fill material required to construct fills to lines and grades indicated on the drawings.
- All water required for the construction of this project shall be purchased from the Sedalia Water Department through the use of a fire hydrant water meter. Meters can be obtained from the Water Department for a fee, refundable upon return of the meter. All costs for water shall be the Contractor's responsibility, subsidiary to other contract payment items.
- If water seepage is encountered during excavation, use of temporary dewatering techniques may be necessary at no additional cost to the City.
- The Contractor shall not be allowed to work Sunday. Holidays and Saturday work shall be approved by the City's Representative.
- The Contractor shall notify property owners a minimum of 48 hours prior to any construction activities or as designated in the plans.
- The Contractor shall be solely responsible for the safety of the construction workers and the public.
- All benchmarks, control points, property markers and right-of-way monuments disturbed or destroyed shall be reset by a Missouri registered land surveyor at the Contractor's expense.
- All existing drain lines (sump pump, foundation drains, roof drains, etc.) shall be extended to the nearest inlet. All bends and fittings shall be considered subsidiary to 6" HDPE drain pipe.
- The Contractor shall be responsible for submitting a traffic control plan for each project location subject to the approval of the City's Representative prior to the start of construction. All work required for traffic control shall be subsidiary to other items of the bid.
- All Riprap shall meet the requirements of Section 2600 of the APWA KCMetro Specifications, latest edition.
- MoDOT and FHWA may make inspections of the work and the contractor shall grant them access to all parts of the work.


SURVEY DATUM

Missouri State Plane (Central Zone), NAVD88 Geoid 12A, US Survey Feet.

SUMMARY OF QUANTITIES

ITEM NO.	DESCRIPTION	QUANTITY	UNIT
<b>BASE BID - Roadway</b>			
1	Mobilization	1	LS
2	Demolition and Site Preparation	1	LS
3	Construction Staking	1	LS
4	Construction Signs	203	SF
5	Type III Movable Barricades	16	EACH
6	Inlet Protection	11	EACH
7	Erosion Control Log	25	LF
8	Construction Entrance	3	EACH
9	Unclassified Excavation	2023	CY
10	Concrete Coal Chute Backfill	20	CY
11	Basement Opening Structural Slab	264	SF
12	6" Fiber Reinforced Concrete Pavement	2342	SY
13	6" Type 1 Base	2909	SY
14	Subgrade Fabric	2909	SY
15	2" Cold Milling	120	SY
16	2" Asphaltic Concrete Surface (Type 5-01)	120	SY
17	Brick Paver Crosswalks	1169	SF
18	Concrete Curb and Gutter	1092	LF
19	4" Concrete Sidewalk	5753	SF
20	Inlaid Brick Pavers at Sidewalk	1584	SF
21	Brick Paver Installation (City Provided Pavers)	150	SF
22	Sidewalk Ramp	9	EACH
23	4" Type 1 Base	925	SY
24	8" Concrete Driveway	126	SY
25	6'x4' Curb Inlet (Special)	7	EACH
26	6'x6' Curb Inlet (Special)	1	EACH
27	4x4' Junction Box	1	EACH
28	6" HDPE	42	LF
29	15" HDPE	272	LF
30	24" HDPE	209	LF
31	30" HDPE	75	LF
32	4" Solid White Line	304	LF
33	24" Stop Bar	73	LF
34	No Parking Zone Line	132	LF
35	Permanent Signs	19	EACH
<b>BASE BID - Street Lighting</b>			
36	Street Light Pole Base	19	EACH
37	Pull Box Installation (Class 1) (KCPL Provided)	6	EACH
38	Conduit, 2" Sch. 40 PVC	1078	LF
39	Pull String	1078	LF
<b>ADD ALTERNATE 1 - N. Ohio Ave</b>			
1	Mobilization	1	LS
2	Demolition and Site Preparation	1	LS
3	Construction Staking	1	LS
4	Construction Signs	109	SF
5	Type III Movable Barricades	6	EACH
6	Construction Entrance	1	EACH
7	Unclassified Excavation	323	CY
8	6" Fiber Reinforced Concrete Pavement	420	SY
9	6" Type 1 Base	442	SY
10	Subgrade Fabric	442	SY
11	Concrete Curb and Gutter	99	LF
12	4" Concrete Sidewalk	557	SF
13	Inlaid Brick Pavers at Sidewalk	192	SF
14	4" Type 1 Base	83	SY
15	24" Stop Bar	56	LF
16	4" Double Solid Yellow Line	98	LF
17	Railroad Crossing Symbol	1	EACH
18	Street Light Pole Base	2	EACH
19	Conduit, 2" Sch. 40 PVC	102	LF
20	Pull String	102	LF

**WILSON & COMPANY**  
 800 EAST 101ST TERRACE, SUITE 200  
 KANSAS CITY, MO 64131  
 PHONE: 816-701-3100  
 FAX: 816-942-3013  
 www.wilsonco.com  
 Cert. of Authority # 2003007699

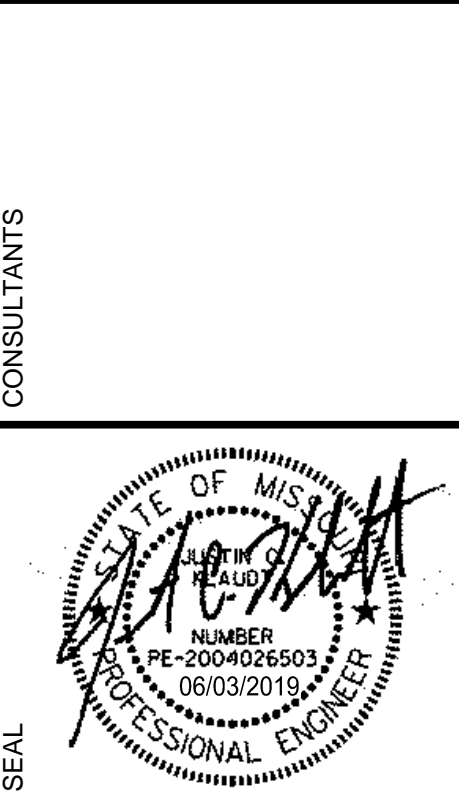

**PROJECT NAME**  
 CITY OF SEDALIA, MO  
 DOWNTOWN STREETSCAPE  
 CITY PROJECT NO. 2019-03  
 FEDERAL PROJECT NO.  
 STP-5700(511)


REV.	DATE	DESCRIPTION	BY

PROJECT NO: 14-100-509-09  
 DESIGNED BY: GJL, DJM  
 DRAWN BY: GJL, DJM  
 CHECKED BY: JCK, CDP  
 DATE: 6/3/2019

SHEET TITLE  
**GENERAL NOTES & SUMMARY OF QUANTITIES**

SHEET NO:  
**C-001**

6/24/2019 M:\TRN\14-100-509-002\_Disciplines\_SHEETS2\_Sheets - civil\14150909 - Streetscape\14150909-Intersection Details.dwg

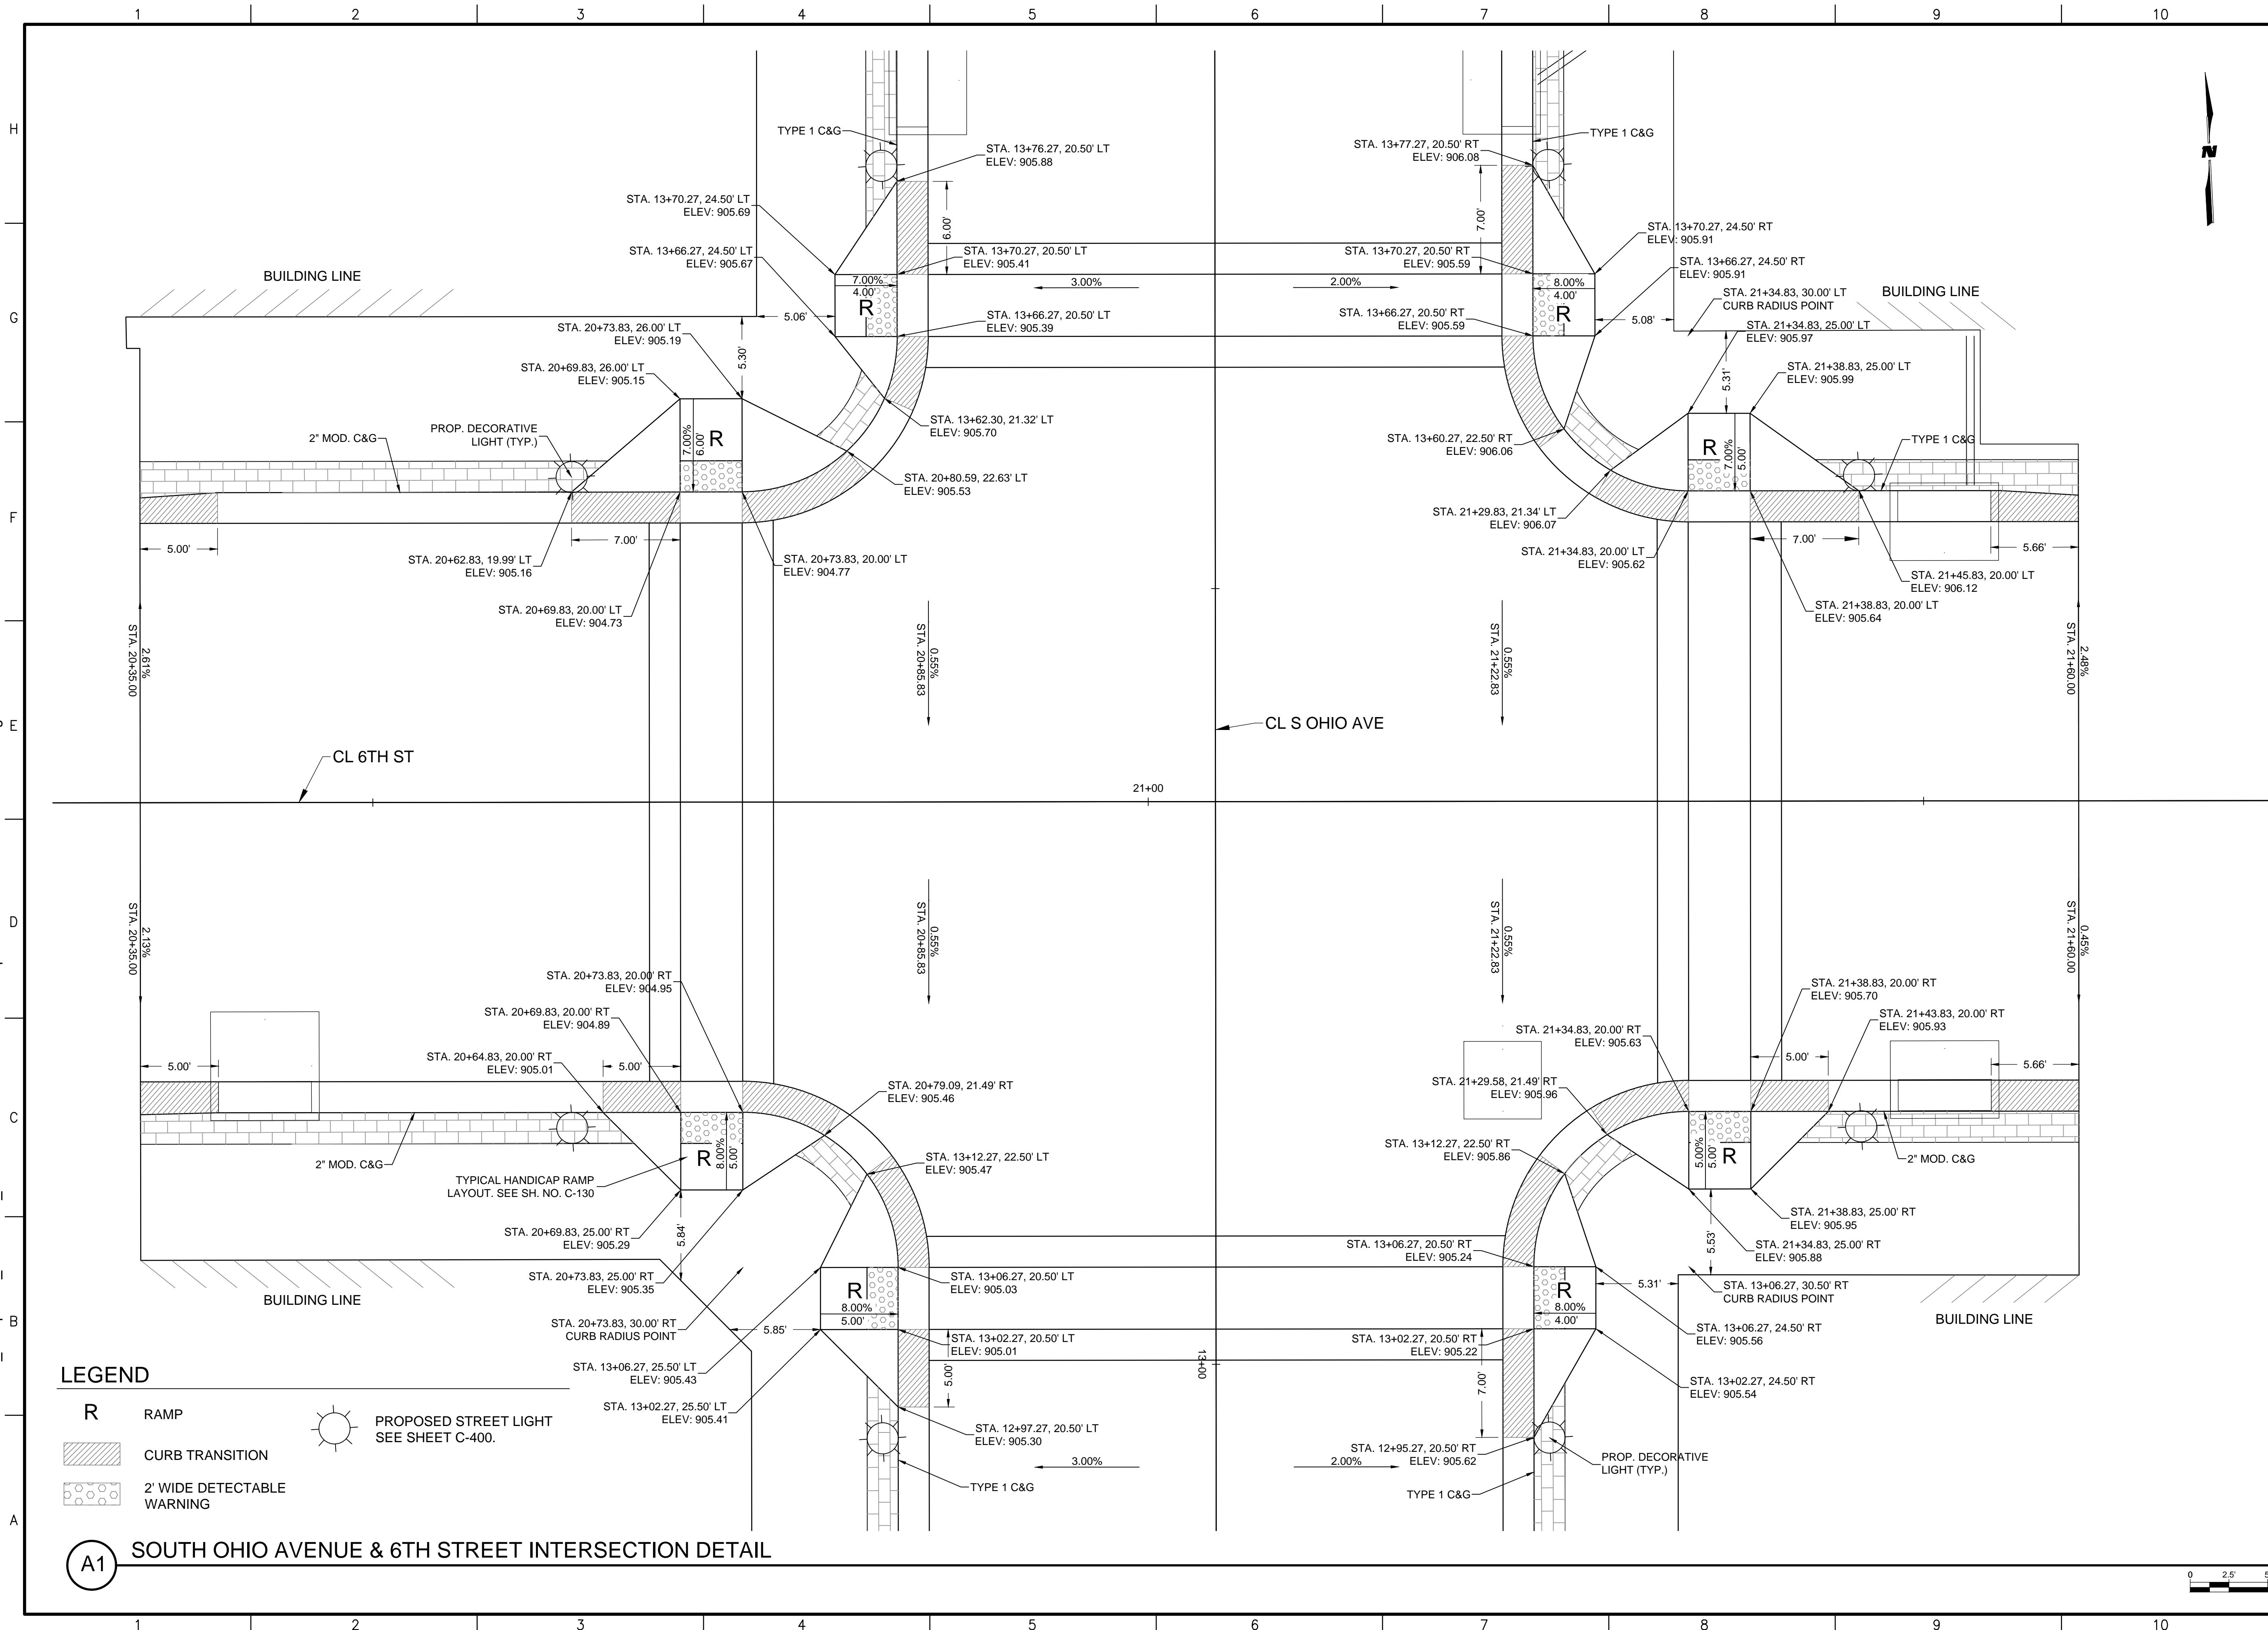


**LEGEND**

- R RAMP
- CURB TRANSITION
- 2' WIDE DETECTABLE WARNING
- PROPOSED STREET LIGHT  
SEE SHEET C-400.

**(A1) SOUTH OHIO AVENUE & 6TH STREET INTERSECTION DETAIL**



**WILSON & COMPANY**  
 800 EAST 101ST TERRACE, SUITE 200  
 KANSAS CITY, MO 64131  
 PHONE: 816-701-3100  
 FAX: 816-942-3013  
 www.wilsonco.com  
 Cert. of Authority # 2003007599

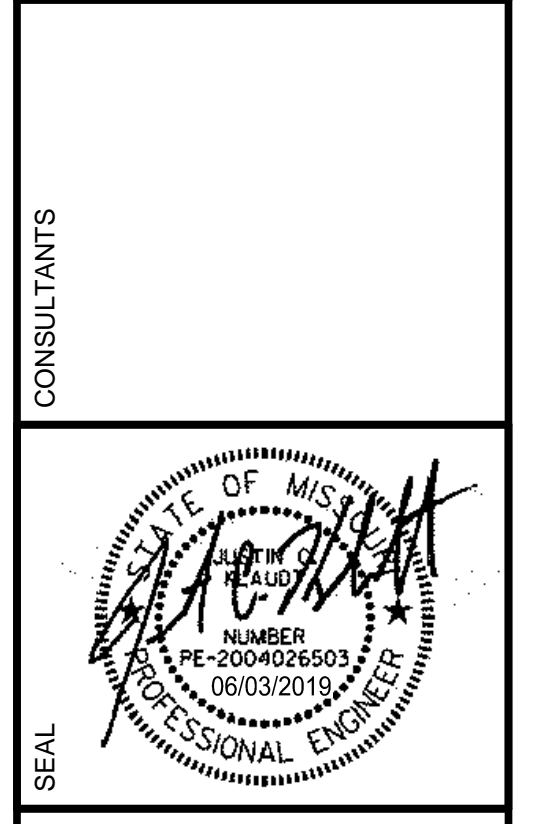

**PROJECT NAME**  
 CITY OF SEDALIA, MO  
 DOWNTOWN STREETSCAPE  
 CITY PROJECT NO. 2019-03  
 FEDERAL PROJECT NO.  
 STP-5700(511)


REV.	DATE	DESCRIPTION	BY

PROJECT NO: 14-100-509-09  
 DESIGNED BY: GJL, DJM  
 DRAWN BY: GJL, DJM  
 CHECKED BY: JCK, CDP  
 DATE: 6/3/2019

SHEET TITLE  
**INTERSECTION  
 DETAIL - S OHIO &  
 6TH**

SHEET NO:  
**C-120**

6/27/2019 M:\TRN\14-100-509-002\_Disciplines\_SHEETS2\_Sheets - civil\14150909 - Streetscape\14150909-Pavement Markings.dwg

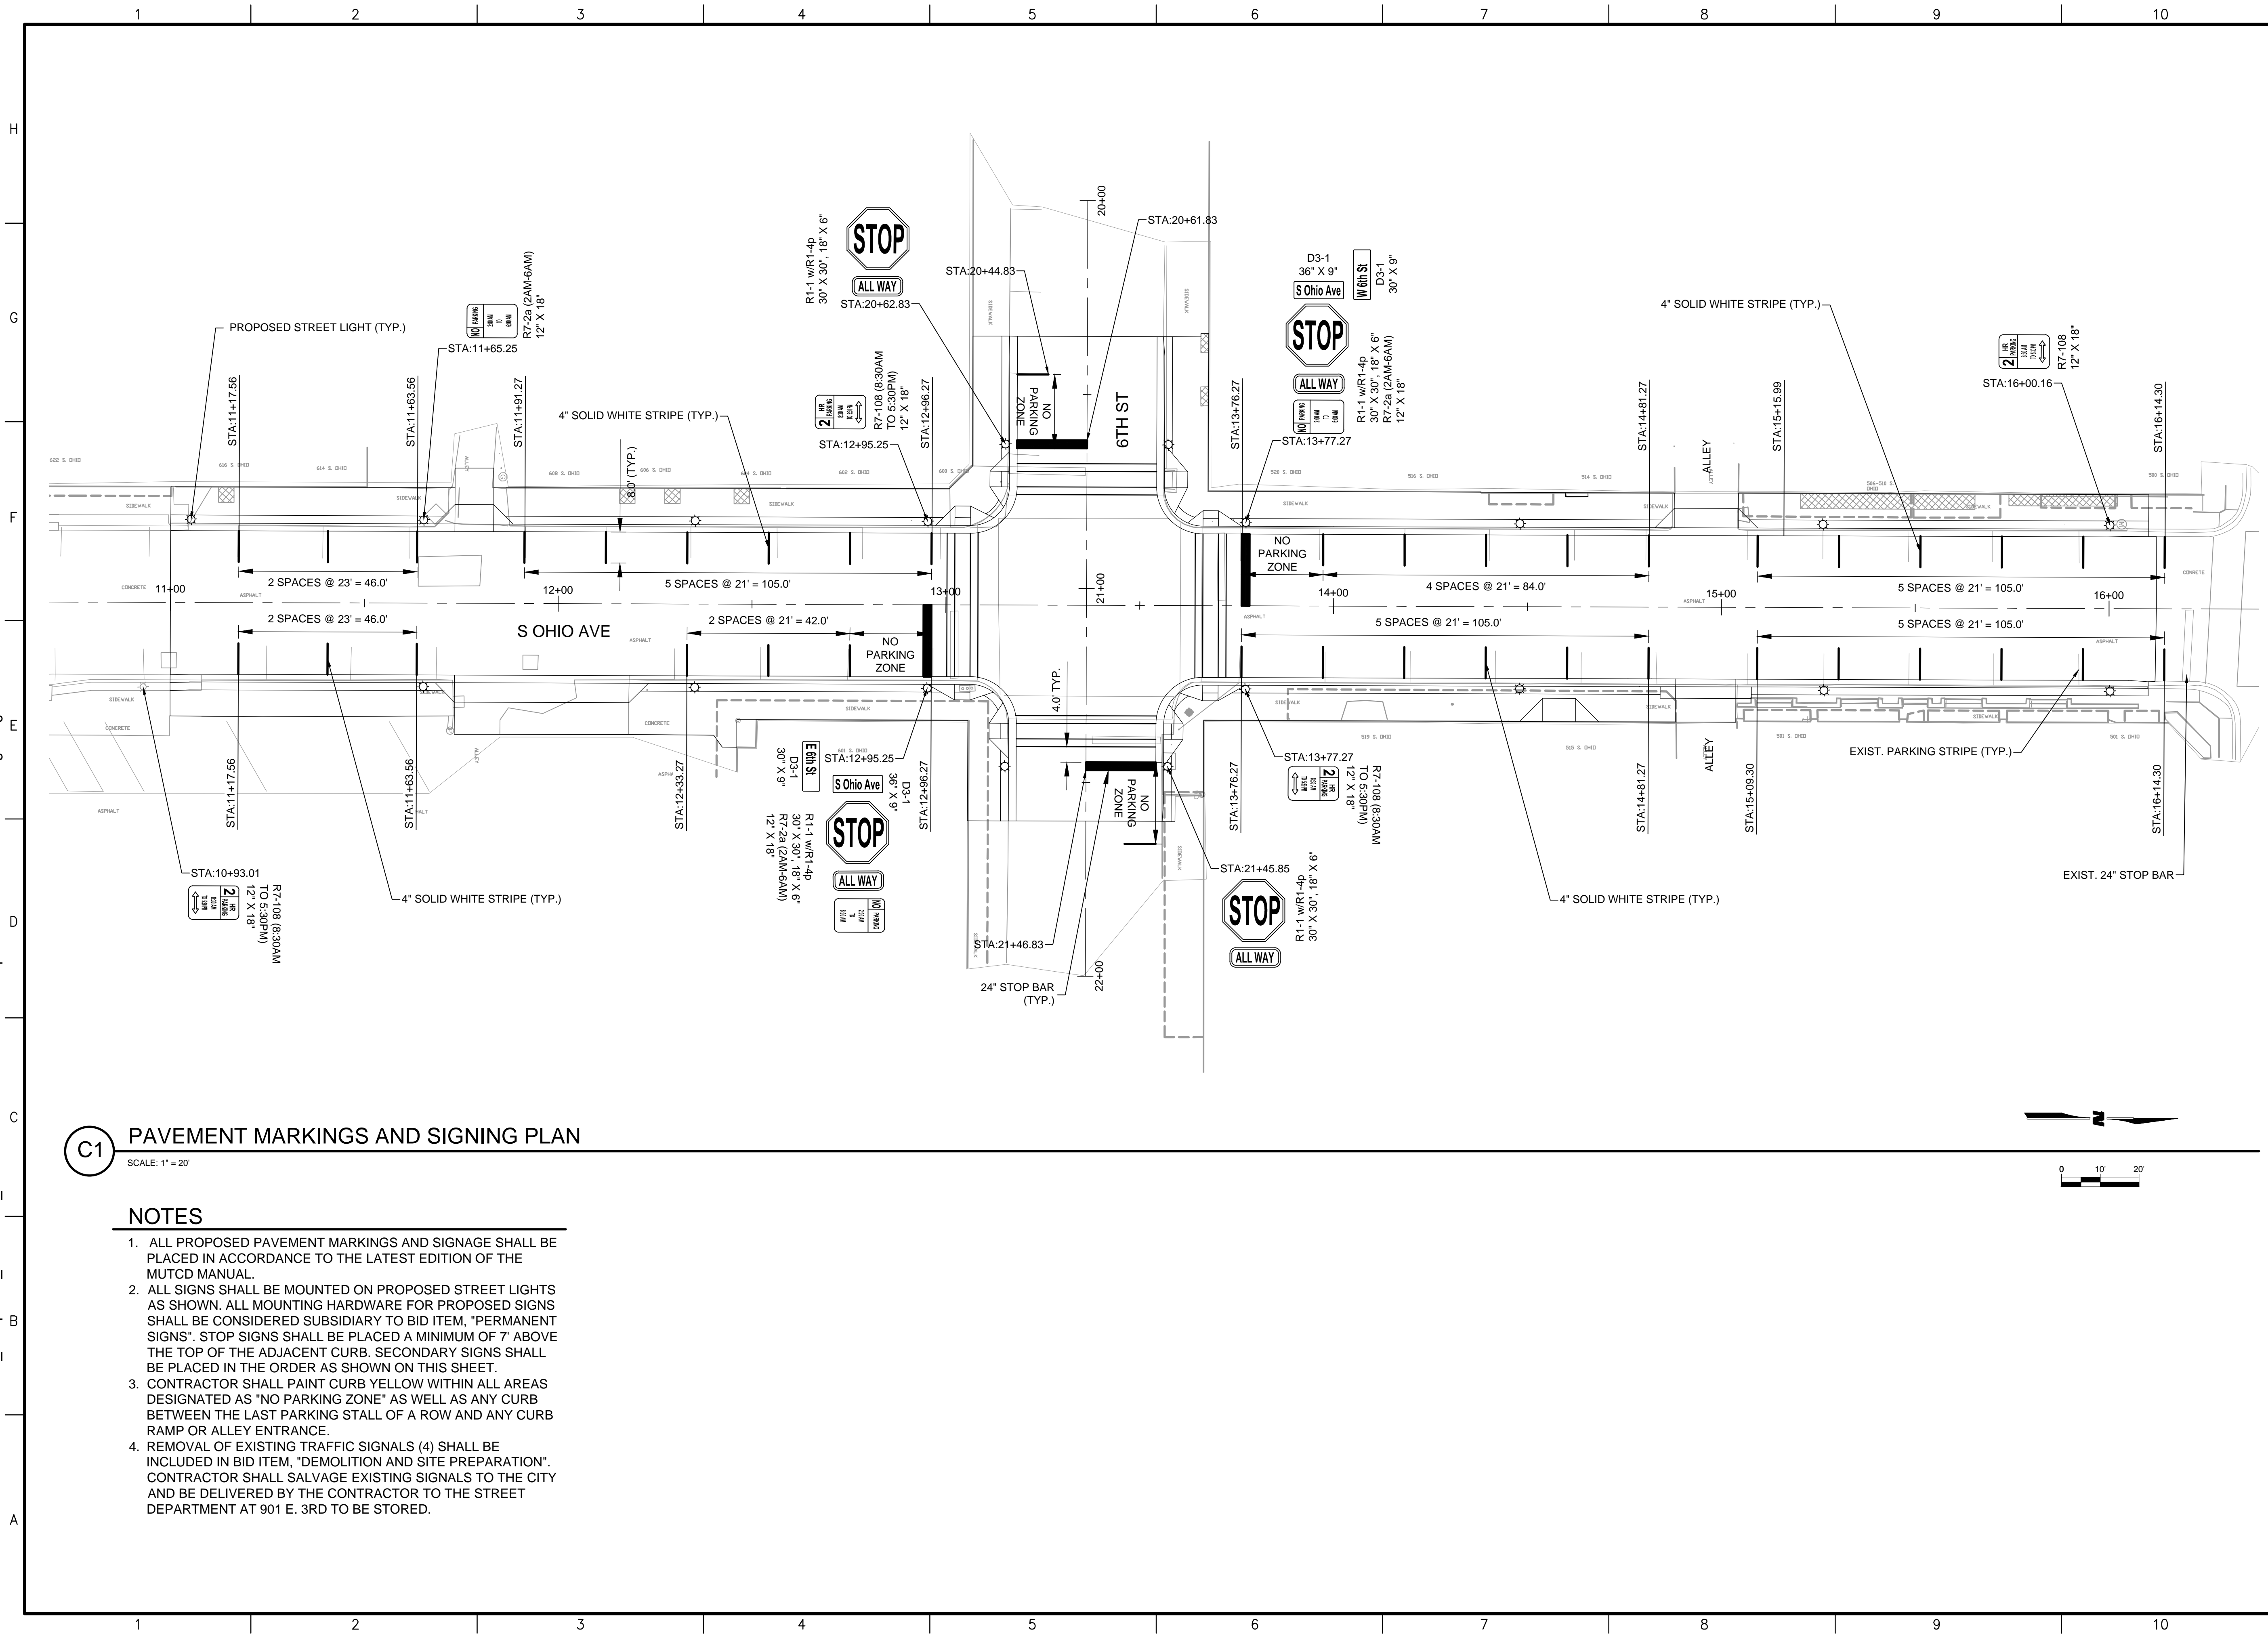


**C1 PAVEMENT MARKINGS AND SIGNING PLAN**

SCALE: 1" = 20'

**NOTES**

1. ALL PROPOSED PAVEMENT MARKINGS AND SIGNAGE SHALL BE PLACED IN ACCORDANCE TO THE LATEST EDITION OF THE MUTCD MANUAL.
2. ALL SIGNS SHALL BE MOUNTED ON PROPOSED STREET LIGHTS AS SHOWN. ALL MOUNTING HARDWARE FOR PROPOSED SIGNS SHALL BE CONSIDERED SUBSIDIARY TO BID ITEM, "PERMANENT SIGNS". STOP SIGNS SHALL BE PLACED A MINIMUM OF 7' ABOVE THE TOP OF THE ADJACENT CURB. SECONDARY SIGNS SHALL BE PLACED IN THE ORDER AS SHOWN ON THIS SHEET.
3. CONTRACTOR SHALL PAINT CURB YELLOW WITHIN ALL AREAS DESIGNATED AS "NO PARKING ZONE" AS WELL AS ANY CURB BETWEEN THE LAST PARKING STALL OF A ROW AND ANY CURB RAMP OR ALLEY ENTRANCE.
4. REMOVAL OF EXISTING TRAFFIC SIGNALS (4) SHALL BE INCLUDED IN BID ITEM, "DEMOLITION AND SITE PREPARATION". CONTRACTOR SHALL SALVAGE EXISTING SIGNALS TO THE CITY AND BE DELIVERED BY THE CONTRACTOR TO THE STREET DEPARTMENT AT 901 E. 3RD TO BE STORED.

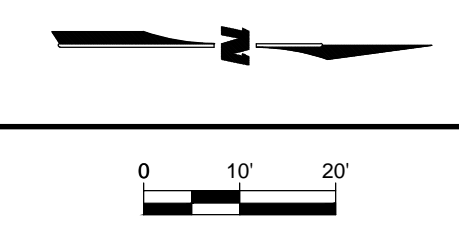

**WILSON & COMPANY**  
 800 EAST 101ST TERRACE, SUITE 200  
 KANSAS CITY, MO 64131  
 PHONE: 816-701-3100  
 FAX: 816-942-3013  
 www.wilsonco.com  
 Cert. of Authority # 2003007599

CONSULTANTS

SEAL

PROJECT NAME  
 CITY OF SEDALIA, MO  
 DOWNTOWN STREETSCAPE  
 CITY PROJECT NO. 2019-03  
 FEDERAL PROJECT NO.  
 STP-5700(511)


REV.	DATE	DESCRIPTION	BY

PROJECT NO: 14-100-509-09  
 DESIGNED BY: GJL, DJM  
 DRAWN BY: GJL, DJM  
 CHECKED BY: JCK, CDP  
 DATE: 6/3/2019

SHEET TITLE  
**PAVEMENT MARKING AND SIGNING PLAN - S OHIO AVE**

SHEET NO:  
**C-310**

6/27/2019 M:\TRN\14-100-509-002\_Disciplines\_SHEETS2\_Sheets - civil\14150909 - Streetscape\14150909-Street Lighting.dwg

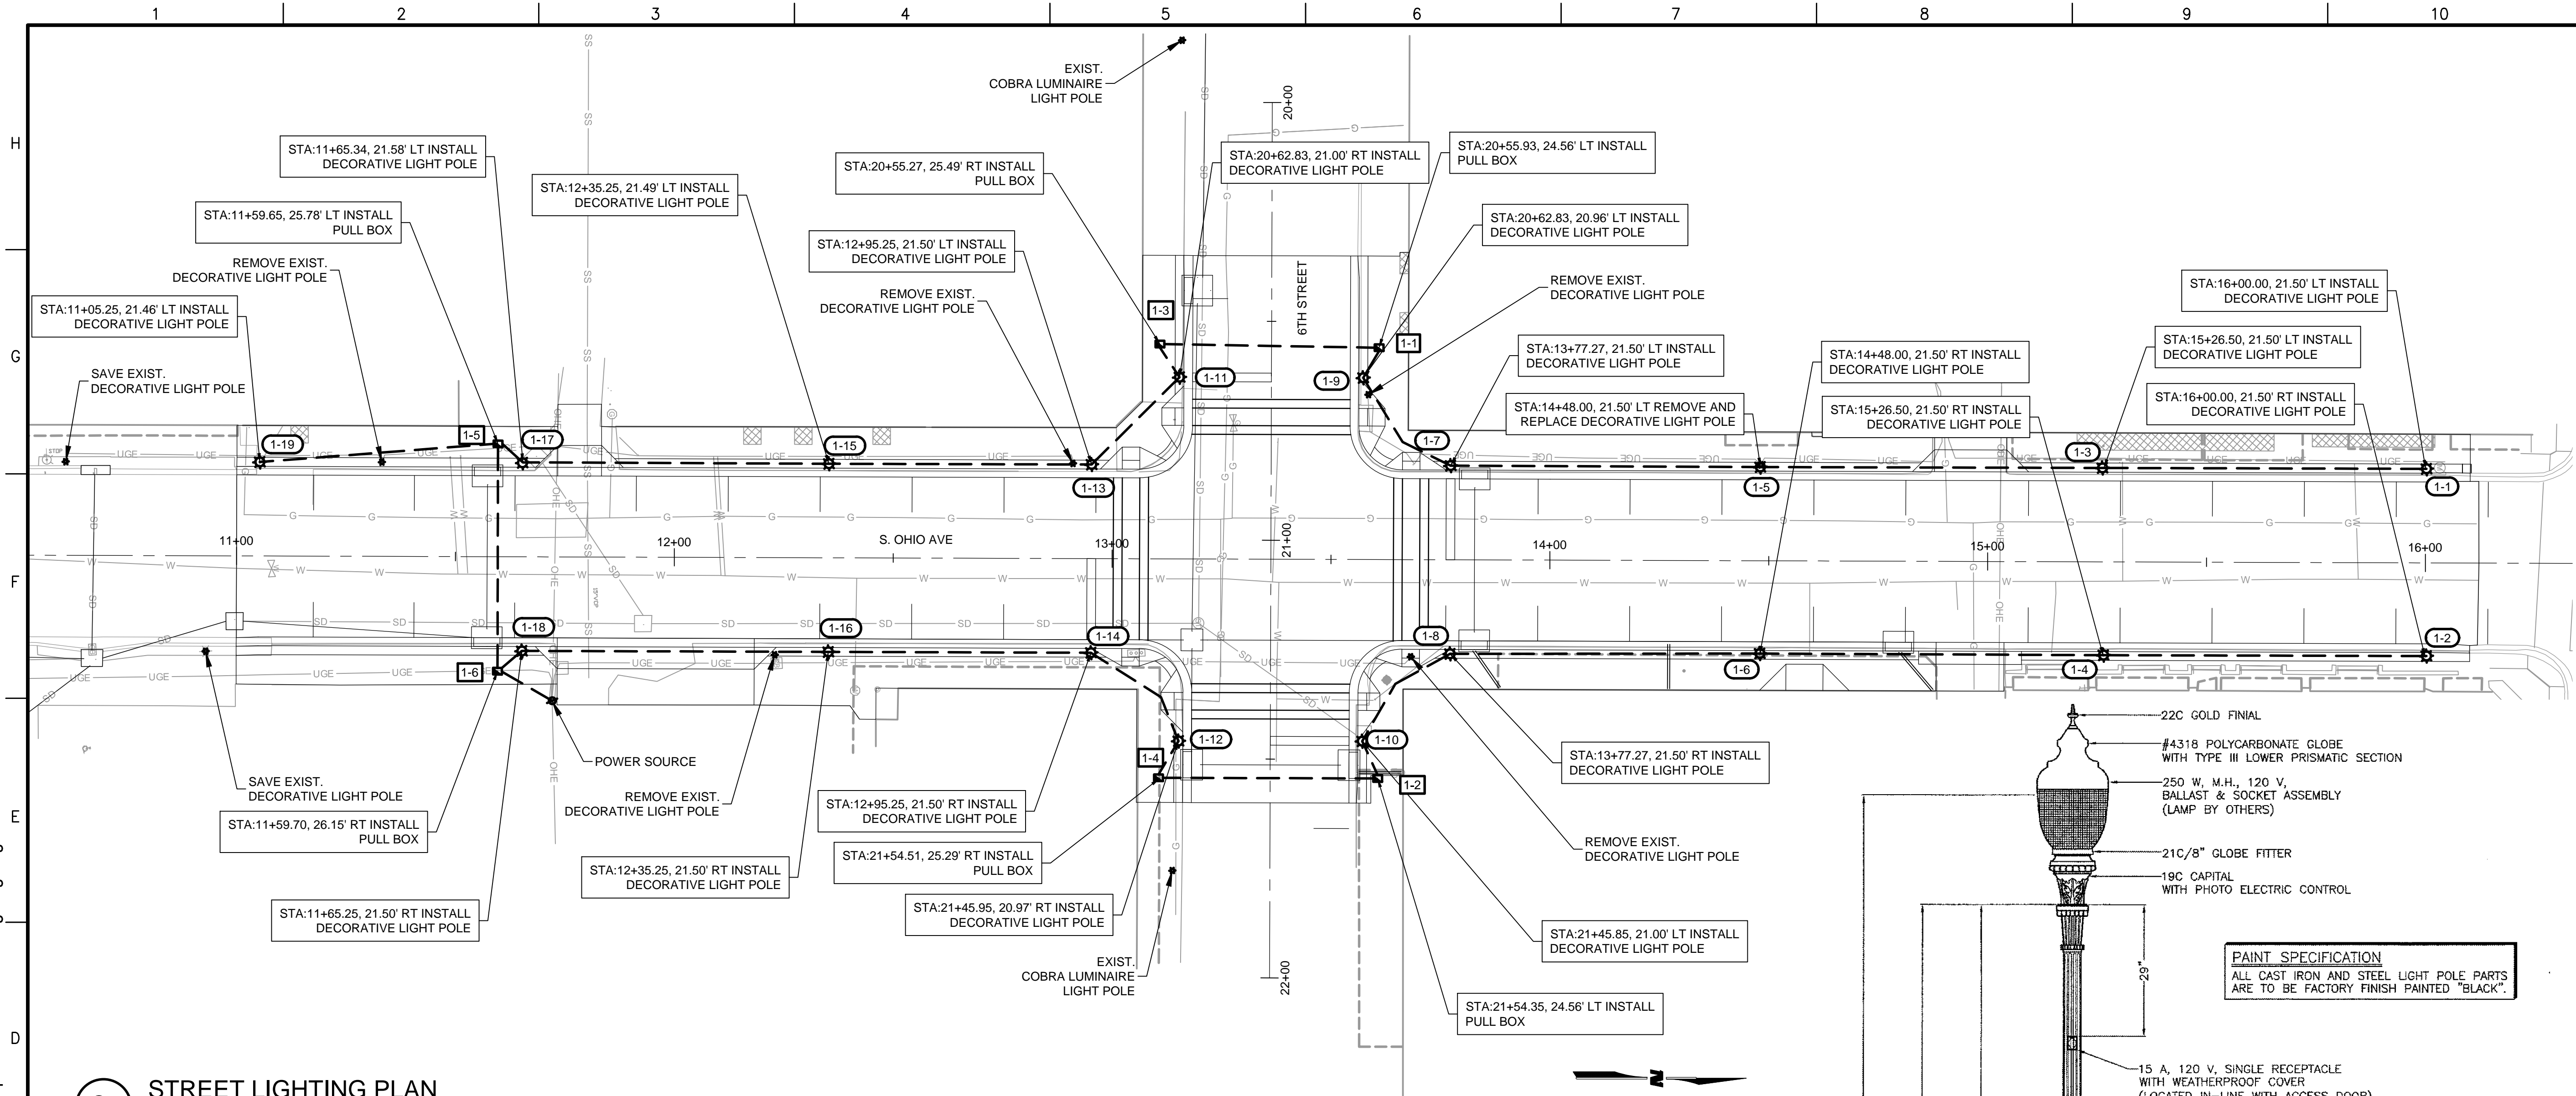


**C1 STREET LIGHTING PLAN**  
SCALE: 1" = 20'


**LEGEND**

- PROPOSED LIGHTING
- EXISTING LIGHTING
- PULL BOX
- CONDUIT
- POWER SOURCE
- PROPOSED LIGHTING LABEL
- PROPOSED PULL BOX LABEL
- METERED SERVICE PEDESTAL

- NOTES**
- CONTRACTOR FOR THIS PROJECT SHALL PROVIDE AND INSTALL LIGHT POLE BASES, 2" SCH. 40 PVC CONDUIT, AND PULL STRING AS SHOWN ON THIS SHEET. KCPL TO PROVIDE GALVANIZED ANCHOR BOLTS AND PULL BOXES FOR THE CONTRACTOR TO INSTALL AS WELL. KCPL TO PROVIDE AND INSTALL PROPOSED DECORATIVE LIGHT POLES, CONDUCTORS, AND FIXTURES. COORDINATE ALL SITE LIGHTING WORK WITH KCPL AND THE CITY.
  - EXISTING LIGHT POLES TO BE REMOVED BY CONTRACTOR SHALL BE INCLUDED IN BID ITEM, "DEMOLITION AND SITE PREPARATION". EXISTING POLES SHALL BE SALVAGED TO KCPL TO RETIRE.
  - CATALOG CUTS AND FINAL LOCATION SHALL BE APPROVED BY THE CITY PRIOR TO PROCUREMENT AND INSTALLATION.

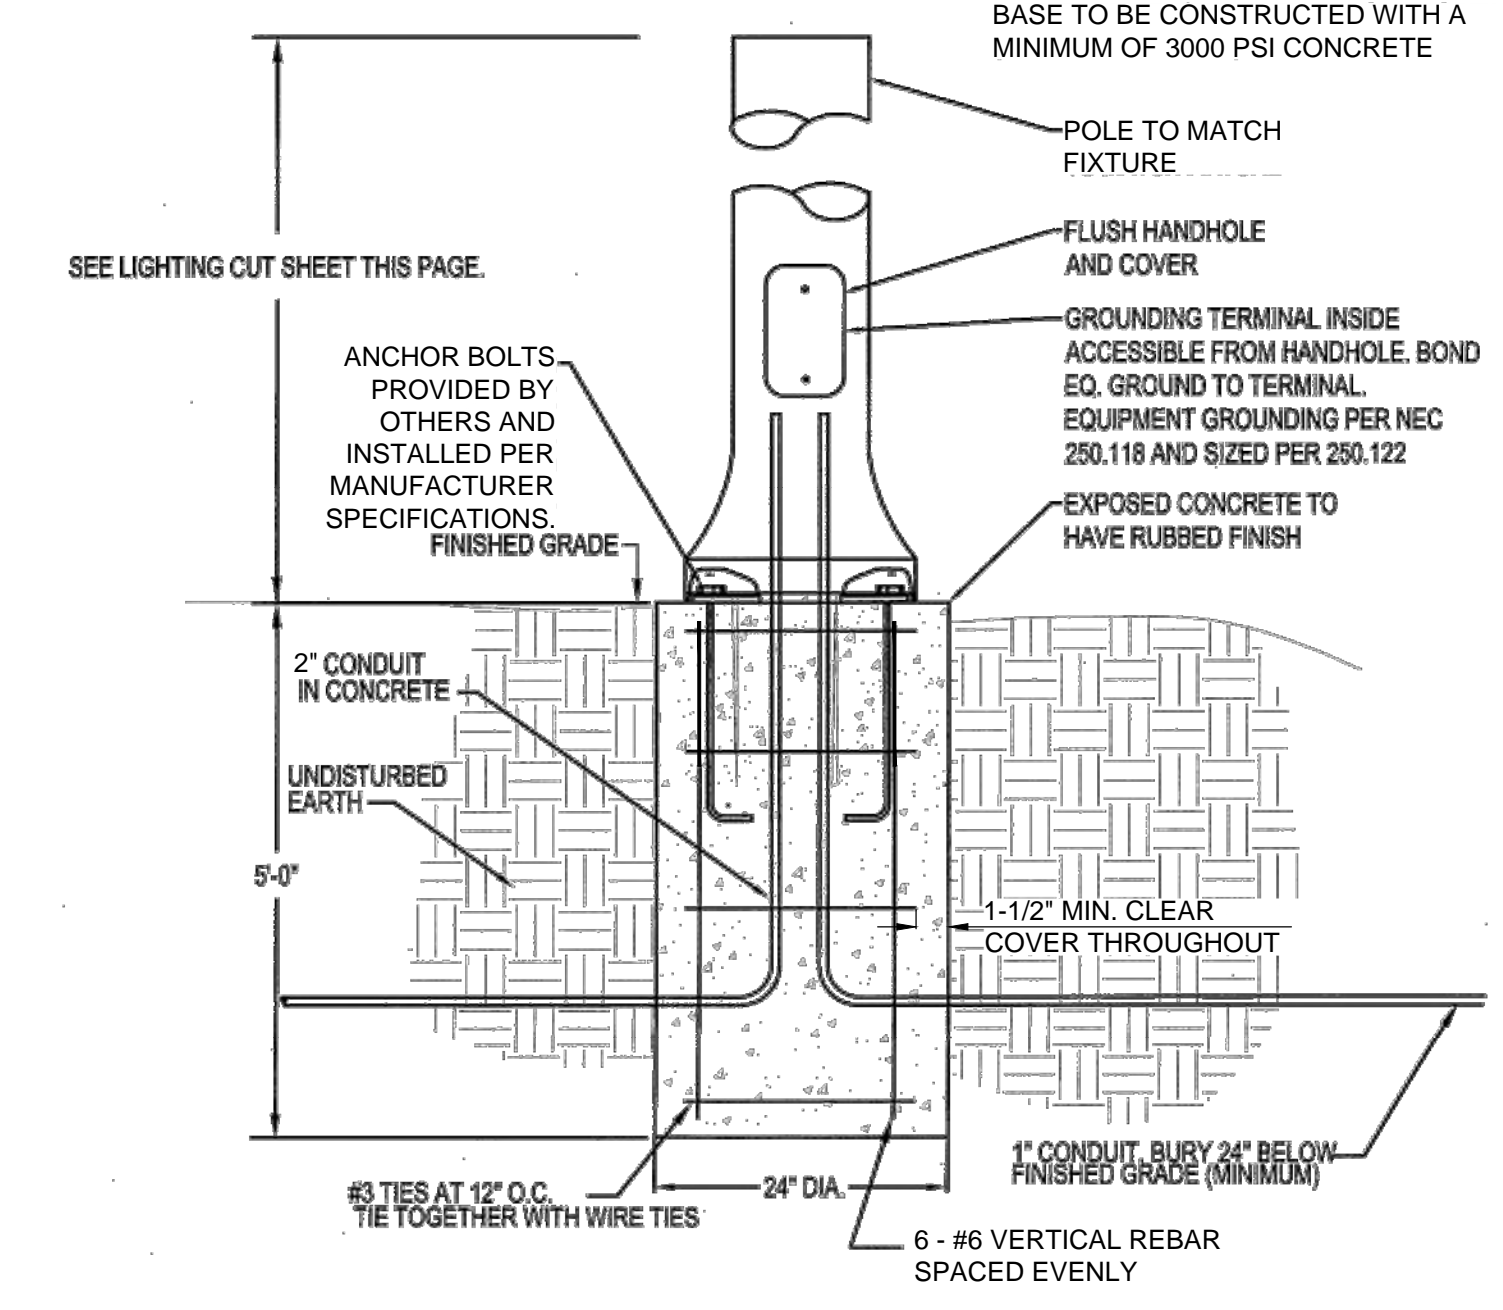


**C7 TYPICAL POLE BASE DETAIL**  
NOT TO SCALE

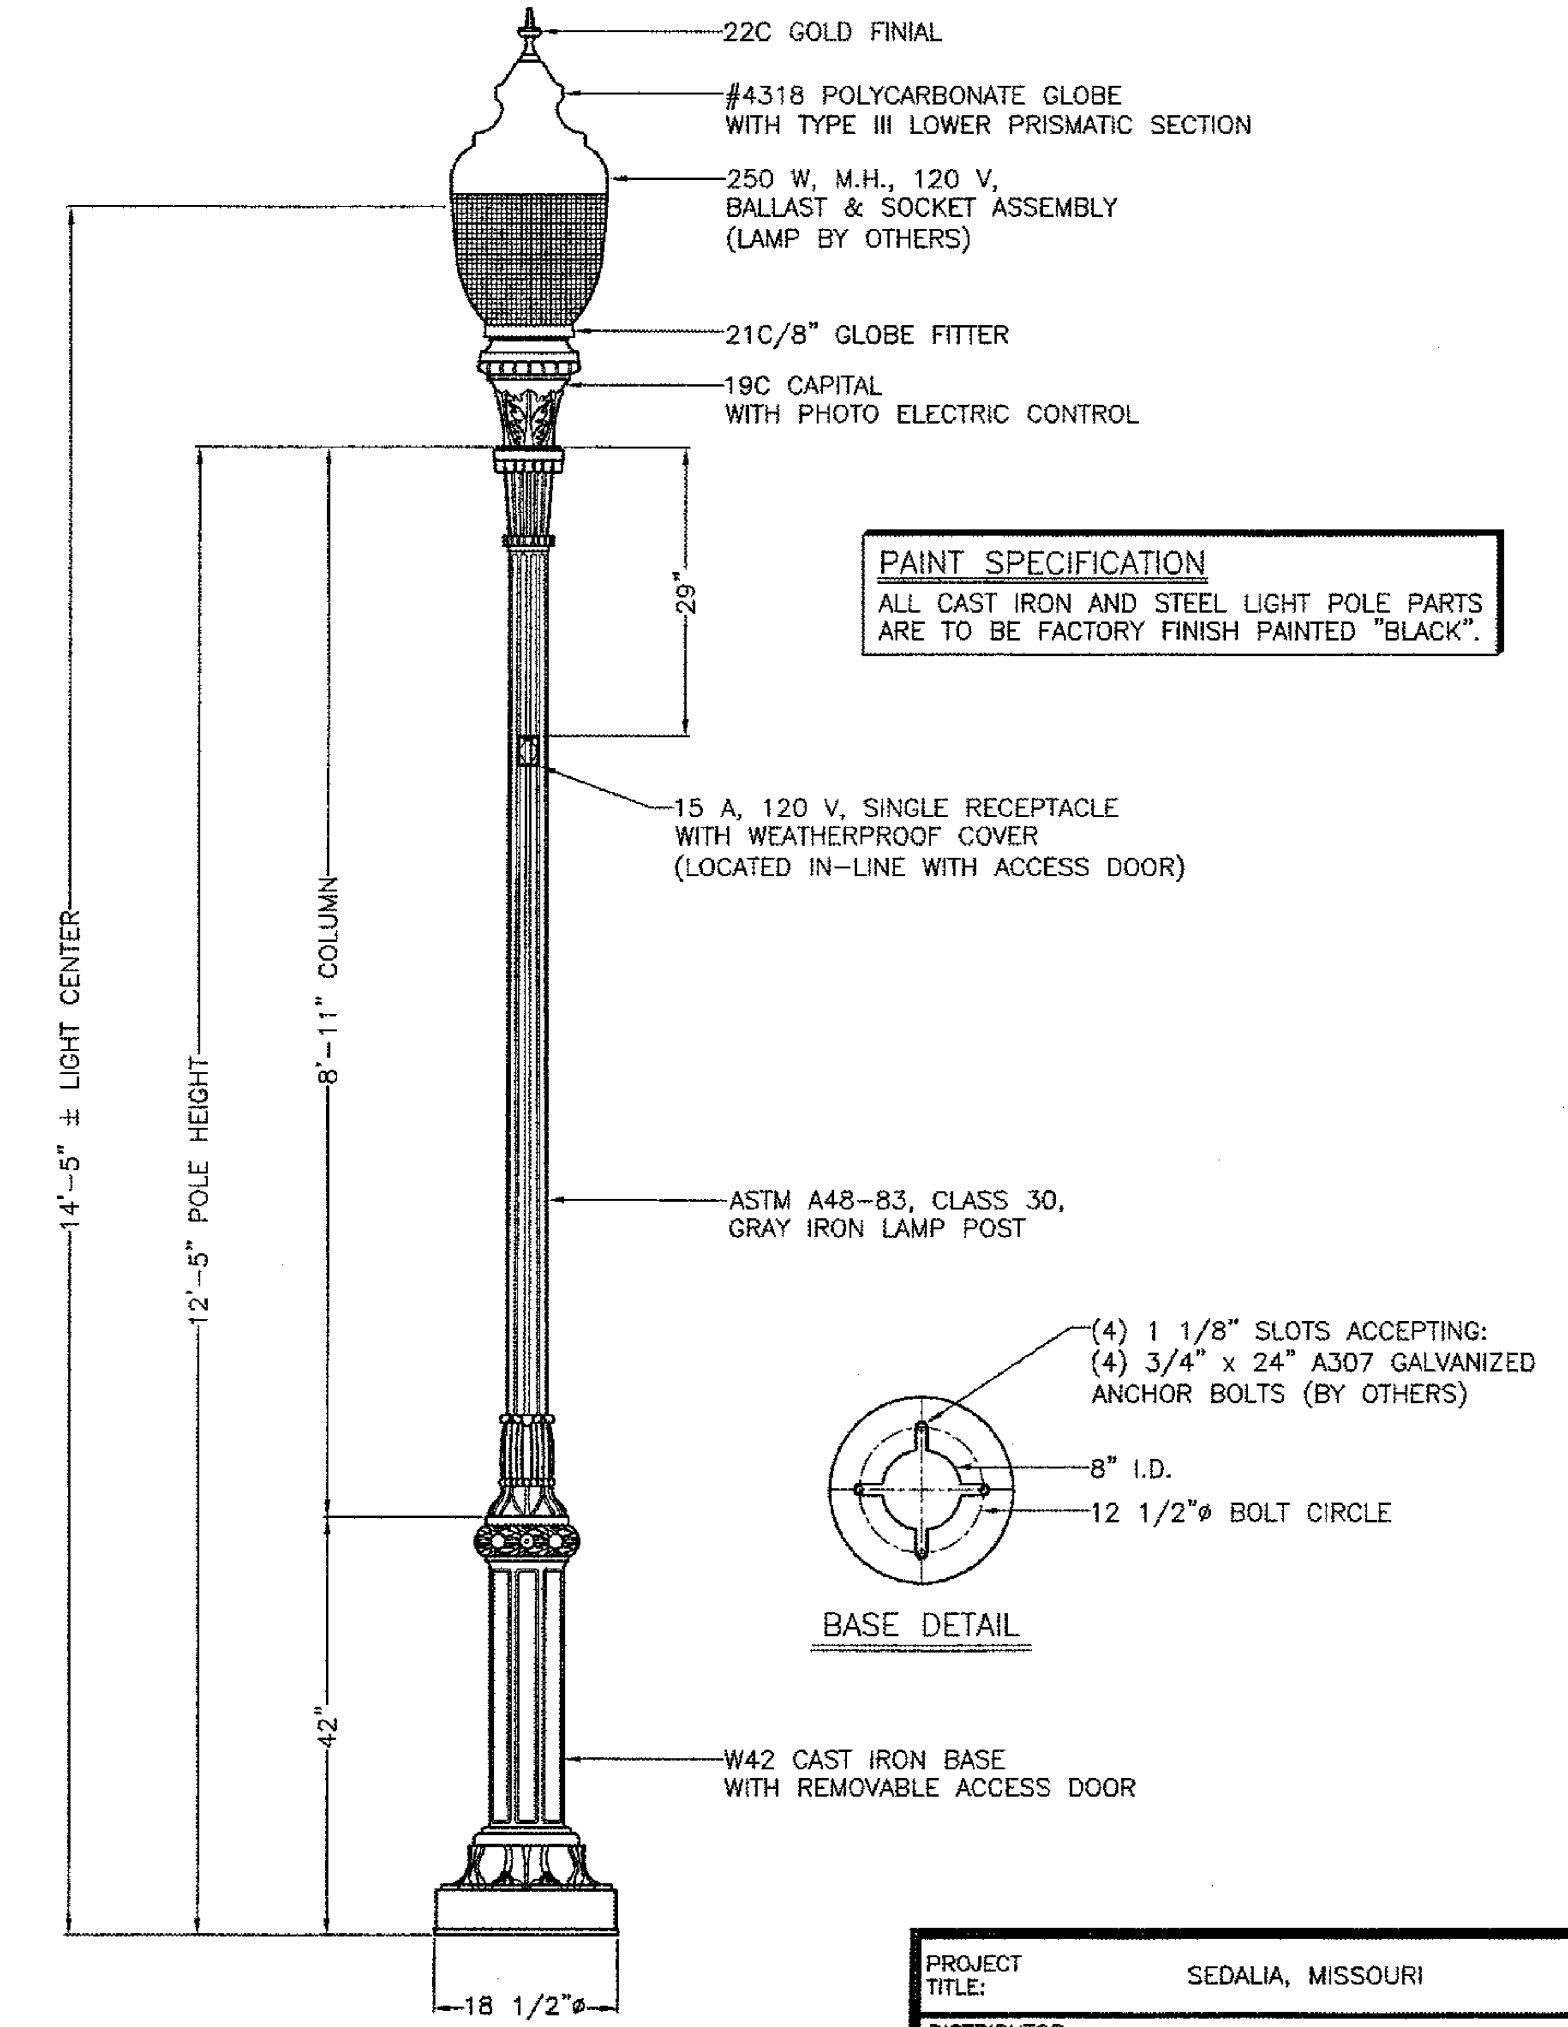

**C8 DECORATIVE LIGHT POLE DETAIL**  
NOT TO SCALE

PROJECT TITLE:	SEDALIA, MISSOURI
DISTRIBUTOR:	
CONTRACTOR:	
REPRESENTATIVE:	POWER EQUIPMENT SALES COMPANY
SPECIFIED BY:	
SCALE:	DATE:
JOB NO.:	CAD FILE:

**WILSON & COMPANY**  
800 EAST 101ST TERRACE, SUITE 200  
KANSAS CITY, MO 64131  
PHONE: 816-701-3100  
FAX: 816-942-3013  
www.wilsonco.com  
Cert. of Authority # 2003007699

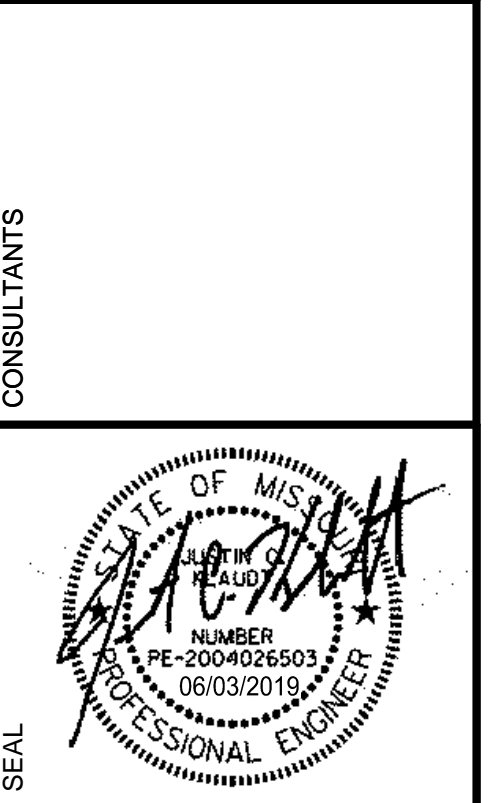

**PROJECT NAME**  
CITY OF SEDALIA, MO  
DOWNTOWN STREETSCAPE  
CITY PROJECT NO. 2019-03  
FEDERAL PROJECT NO.  
STP-5700(511)

REV.	DATE	DESCRIPTION	BY

PROJECT NO: 14-100-509-09  
DESIGNED BY: GJL, DJM  
DRAWN BY: GJL, DJM  
CHECKED BY: JCK, CDP  
DATE: 6/3/2019

SHEET TITLE  
**STREET LIGHTING PLAN - S OHIO AVE**  
SHEET NO:  
**C-400**



## PROPOSAL

### TO THE CITY OF SEDALIA, MISSOURI:

Pursuant to and in compliance with the Notice to Contractors and having examined the plans and specifications with related documents and the site(s) of the proposed work, the undersigned bidder proposes and agrees, if this proposal is accepted, to furnish all labor, materials, tools, supplies, equipment and supervision and to do all other work necessary for the **DOWNTOWN STREETScape, PHASE IV, City Project No. 2019-03, Federal Project No. STP-5700(511)**, as noted in these contract documents for the following price(s):

**NOTE: IN THE EVENT OF DISCREPANCY, UNIT PRICE SHALL GOVERN**

### **BID FORM**

**Sedalia Downtown Streetscape, Phase IV**

**July 11, 2019**

ITEM NO.	DESCRIPTION	QUANTITY	UNIT	UNIT PRICE	TOTAL PRICE
----------	-------------	----------	------	------------	-------------

#### ***Roadway (Base Bid)***

1	Mobilization	1	LS		
2	Demolition and Site Preparation	1	LS		
3	Construction Staking	1	LS		
4	Construction Signs	203	SF		
5	Type III Movable Barricades	16	EACH		
6	Inlet Protection	11	EACH		
7	Erosion Control Log	25	LF		
8	Construction Entrance	3	EACH		
9	Unclassified Excavation	2023	CY		
10	Concrete Coal Chute Backfill	20	CY		
11	Basement Opening Structural Slab	264	SF		
12	6" Fiber Reinforced Concrete Pavement	2342	SY		
13	6" Type 1 Base	2909	SY		
14	Subgrade Fabric	2909	SY		
15	2" Cold Milling	120	SY		
16	2" Asphaltic Concrete Surface (Type 5-01)	120	SY		
17	Brick Paver Crosswalks	1169	SF		
18	Concrete Curb and Gutter	1092	LF		
19	4" Concrete Sidewalk	5753	SF		
20	Inlaid Brick Pavers at Sidewalk	1584	SF		
21	Brick Paver Installation (City Provided Pavers)	150	SF		
22	Sidewalk Ramp	9	EACH		
23	4" Type 1 Base	925	SY		
24	8" Concrete Driveway	126	SY		
25	6'x4' Curb Inlet (Special)	7	EACH		

26	6'x6' Curb Inlet (Special)	1	EACH		
27	4'x4' Junction Box	1	EACH		
28	6" HDPE	42	LF		
29	15" HDPE	272	LF		
30	24" HDPE	209	LF		
31	30" HDPE	75	LF		
32	4" Solid White Line	304	LF		
33	24" Stop Bar	73	LF		
34	No Parking Zone Line	132	LF		
35	Permanent Signs	19	EACH		
<b>Subtotal:</b>					

**Street Lighting (Base Bid)**

36	Street Light Pole Base	19	EACH		
37	Pull Box Installation (Class 1) (KCPL Provided)	6	EACH		
38	Conduit, 2" Sch. 40 PVC	1078	LF		
39	Pull String	1078	LF		
<b>Subtotal:</b>					

**Add Alternate 1**

1	Mobilization	1	LS		
2	Demolition and Site Preparation	1	LS		
3	Construction Staking	1	LS		
4	Construction Signs	109	SF		
5	Type III Movable Barricades	6	EACH		
6	Construction Entrance	1	EACH		
7	Unclassified Excavation	323	CY		
8	6" Fiber Reinforced Concrete Pavement	420	SY		
9	6" Type 1 Base	442	SY		
10	Subgrade Fabric	442	SY		
11	Concrete Curb and Gutter	99	LF		
12	4" Concrete Sidewalk	557	SF		
13	Inlaid Brick Pavers at Sidewalk	192	SF		
14	4" Type 1 Base	83	SY		
15	24" Stop Bar	56	LF		
16	4" Double Solid Yellow Line	98	LF		
17	Railroad Crossing Symbol	1	EACH		
18	Street Light Pole Base	2	EACH		
19	Conduit, 2" Sch. 40 PVC	102	LF		
20	Pull String	102	LF		
<b>Subtotal:</b>					

**TOTAL BASE BID:** \$ \_\_\_\_\_

**TOTAL ADD ALTERNATE 1:** \$ \_\_\_\_\_

**GRAND TOTAL (BASE + ALTERNATE):** \$ \_\_\_\_\_

Bidder acknowledges receipt of the following addenda, which has been considered in the preparation of this bid:

Addendum No. _____	Dated: _____
Addendum No. _____	Dated: _____
Addendum No. _____	Dated: _____

The undersigned agrees, if this proposal is accepted, to complete the work within **a period of 120 calendar days** from the date of the Notice to Proceed.

NAME OF BIDDER: \_\_\_\_\_

BY: \_\_\_\_\_

TITLE: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

DATE: \_\_\_\_\_